

**GOVERNMENT OF ANDHRA PRADESH**  
**STATE DISASTER RESPONSE & FIRE SERVICES DEPARTMENT**

**From :**  
 The Director General,  
 State Disaster Response and Fire Services,  
 Andhra Pradesh, Vijayawada.

**To :**  
 The Management,  
 M/s Tiny Tots English Medium School,  
 located at Sy.No:128, Sullurpet (M),  
 SPSR Nellore District.

**Rc.No.2773/MSB/SR/NLR/2021, Dt: 16.09.2022**

Sir,  
 Sub: A.P. State Disaster Response and Fire Services Department-MSB Section-Issuance of Revised No Objection Certificate for Revised Occupancy to Educational Building of M/s Tiny Tots English Medium School, located at Sy.No:128, Sullurpet (M),SPSR Nellore District -Regarding.

- Ref: 1. AP Gazette Notification No.G-477 (W.No.24 ) Dated.17-06-2022  
 2. NOC for Occupancy issued vide Rc.No.8334/NLR/DFO/2019, Dt.24-06-2019, of District Fire Officer, SPSR Nellore District.  
 3. Application of Educational Building of M/s Tiny Tots English Medium School, located at Sy.No:128, Sullurpet (M),SPSR Nellore District.

\* \* \* \* \*

1) The Management, M/s Tiny Tots English Medium School, located at Sy.No:128, Sullurpet (M), SPSR Nellore District obtained NOC for Occupancy from this Department vide reference 2<sup>nd</sup> cited to the existing building with Block-A having Ground + (01) upper floor with a height of the building 07.90 Mtrs., with total built-up area has 704.92 Sq Mtrs., and Block-B having Ground + (01) upper floors with a height of 07.90 Mtrs, total built up area of 704.92 Sq.Mtrs., for Educational Occupancy.

2) Now, the Management has constructed Block-A 2<sup>nd</sup> floor & Block-B 2<sup>nd</sup> floor on the existing building and requested for issuance of Revised No Objection Certificate to the entire building and submitted the Affidavit for Hospital building with Block-A having Ground + 02 upper floors with a height of 11.00 Mtrs, total built up area of 986.52 Sq.Mtrs, and Block-B having Ground + (02) upper floors with a height of 11.00 Mtrs, total built up area of 986.52 Sq.Mtrs., and stated that they have provided the following Fire Safety Measures.

3) It is suggested to the Management for providing the following Fire Safety Measures keeping in view of practicality, maintenance and resilience:

Sl.No.	Name of the equipment	:	Fire Safety Measures	Available with Nos.	Deficit
1.	Staircases	:	1) Minimum (02) shall be Provided .If the Second stair case is not possible, provide slider or Tube lift with exhaust fan (connected outside to building) or German chute or horizontal connection between the neighborhood buildings.	02 Nos.	Nil
2.	Fire fighting equipment	:	2) Extinguishers (01 Extinguisher of ABC/CO2 type for each room)	20 Nos.	Nil
			3) Manually operated electronic fire alarm system	06 Nos.	Nil
			4) Underground parking/ Cellar/ Basement (Temperature Sensor connected to "Hooter" and that can be give alerts through Cell phone instead of Sprinklers	NA	Nil
			5) Water Tank 10,000 Ltrs.,	20,000 Ltrs	Nil

Contd....2p.

Sl.No.	Name of the equipment	:	Fire Safety Measures	Available with Nos.	Deficit
			6) 2 HP Motor with triplex Pump Shall be connected to normal plumbing system at Each floor.	2HP-06 Nos.	Nil
			7) Display the following Nos. at important areas (i) Fire Department number. (ii) Ambulance (iii) Police	Displayed	Nil

4) The Management has provided the following Electrical Safety system:

(i)	All Electrical wirings in the building shall confirm the code of practise for Electrical wiring IS:732:1989 and also shall confirm for Fire Safety Wiring of the building Electrical Installations as per IS:1646:2015. Most common mistake is that the neutral wires to the three pin plugs are not of sufficient thickness to carry the current in case of any short circuits.	:	Provided
(ii)	Installation of Miniature Circuit Breakers, (MCBs) in all floors.	:	Provided
(iii)	No Overloading of power socket in any Educational Building.	:	Yes
(iv)	10 years old wiring to be changed specially where ever high power consuming appliances such as Air conditioners, Electrical/Mechanical/Computer labs, Data Centers, High tech labs, MRI machines, X-ray in Medical Colleges etc.,	:	NA
(v)	Grounding /Earthing shall be done. For details refer IS 3043:1987.	:	Provided
(vi)	Lightening conductors may be provided for high rise buildings exceeding 5 floors.	:	NA
(vii)	No High Tension Lines should run inside or in close proximity (< 6 meters) to any Educational institution buildings.	:	Yes
(viii)	All the above safety measures shall be certified by the authorized Electrical Engineer.	:	Certified

5) The Management has stated that, they satisfied with the installations and maintenance of the fire safety equipment working condition in the building and also they declared that no additions or alterations have been made in the building affecting Fire Prevention and Fire Safety Measures including means of escape and that all exits and passages are free from any obstruction.

6) In view of the above, based on the Affidavit submitted by the Management, the Revised No Objection Certificate for Occupancy is issued to the existing building of M/s Tiny Tots English Medium School, located at Sy.No:128, Sullurpet (M), SPSR Nellore District with Block-A having Ground + 02 upper floors with a height of 11.00 Mtrs, total built up area of 986.52 Sq.Mtrs, and Block-B having Ground + (02) upper floors with a height of 11.00 Mtrs, total built up area of 986.52 Sq.Mtrs for Educational Occupancy that highest priority is accorded to Passive Safety measures such as ensuring two exits, not co-locating with highly inflammable shops having cloths, chemical or explosives and following Electrical Safety Checklist (Clause-5) of Gazette notification for educational institutions.

- 7) The Management shall ensure the following conditions:
- (i) The Management is responsible for all risks involved in case of Fire Accident.
  - (ii) This NOC is given based on the information, documents and drawings provided by the applicant. The applicant confirms that the information provided and the documents and drawings submitted are correct. Any deviation noticed will lead to cancellation of NOC without any notice.
  - (iii) The permission accorded does not confer any ownership rights. If it is found that the information furnished is false and fabricated, the permission will be revoked at any stage and the applicant will be liable for criminal prosecution as per IPC.
- 8) It is informed that, the Management is requested to maintain the following conditions compulsorily for safety purpose.


Sl.No.	As Builder	As occupant	As Security Personnel
1	All the fire protection arrangements shall be maintained in good condition at all times.	All the escape/exit routes shall not be kept locked/blocked or encroached	All the occupants must know the correct method of operation of the fire fighting system installed.
2	Any loss of life or property due to non-functioning of fire safety measures and other installations shall be the responsibility of the management.	All occupants shall be trained to operate the fire safety equipment during emergency.	Mock drills should be conducted once in 3 months for initial two years. Thereafter, once in every 6 months.
3	Addition / alteration, if any in the building may be verified by building authority.	Mock drills should be conducted once in 3 months for initial two years. Thereafter, once in every 6 months.	All security personnel shall be trained to operate the fire safety equipment during emergency.
4	This Revised No objection Certificate for occupancy issued only from fire safety point of view.	Raise the alarm if the fire cannot be controlled; Evacuate the area completely at once with nearest safe exit.	Attack the fire using available fire equipment only if you feel capable of controlling. If not, take all steps to isolate the area by closing doors and windows.

9) This Revised No Objection Certificate is issued, subject to the outcome of O.As/W.Ps etc., if any, before Courts etc.,

10) This Revised No Objection Certificate for Occupancy for two blocks is valid for a period of Five years from the date of issue of this letter to the management M/s Tiny Tots English Medium School, located at Sy.No:128, Sullurpet (M), SPSR Neilore District subject to the compliance of above Fire and Electrical Safety Measures. The Owner/ Occupier/ Builder/ Management concerned of the Building shall submit Self Declaration/Affidavit / Certification with regard to working condition of above Fire Safety System every year in the prescribed format and submit/upload the photographs of the Mock Drills conducted in the premises. It is the responsibility of the Builder to maintain the Fire Safety Equipment in good working condition at all times and apply for next Periodical Renewal of No Objection Certificate, duly remitting the User Charges as per G.O., two (02) months before expiry of this of No Objection Certificate.

11) The Management is hereby informed that this NO Objection Certificate is issued subjective to full compliance with provisions of Gazette Notification for Educational Vide No. G-477 (W.No.24 ) Dated.17-06-2022, including Mock Drills

Yours Sincerely,

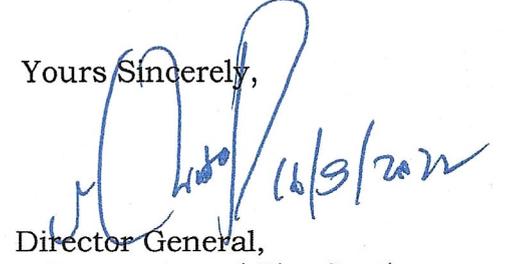

Director General,  
State Disaster Response and Fire Services,  
Andhra Pradesh, Vijayawada.

Copy to the Management of M/s Tiny Tots English Medium School, located at Sy.No:128, Sullurpet (M), SPSR Nellore District.

Copy to the District Educational Officer, SPSR Nellore District.

**Note: In case of any emergency call to 101 or State Fire Control Room-9100108101.**

**Government of Andhra Pradesh**  
**A.P. State Disaster Response and Fire Services Department**  
**Fire No Objection Certificate for Occupancy**

**File No: 27460/TPT/MSB/2025**

**Date: 28/07/2025**

Sir/Madam,

Sub: Andhra Pradesh State Disaster Response and Fire Services Department - Issue of Fire No Objection Certificate for Occupancy to the existing building of **(TINY TOTS EM HIGH SCHOOL) TINY TOTS EM HIGH SCHOOL, Sullurupeta - 524121, Tirupati District, Andhra Pradesh** - Regarding.

Ref: Online Application Dt. 25-07-2025

\*\*\*\*\*


Having satisfied with the reasonable fire safety measures that you have affirmed to have undertaken in your School/College buildings. I hereby grant Occupancy Fire NOC for a period of One year.

1. Ensur two exits/two staircases for orderly evacuation of teachers, students and staff in case of any fire incident or emergency.
2. Conduct Mock Drill @ twice a year with participation of teachers, students and preferably in presence some of the parents. And take signatures of staff, teachers, parents, student leaders affirming their familiarity with the equipment and its functioning.
3. **Ensured Electrical Safety by observing the following Precautions:**
  - a. Installation of Miniature Circuit Breakers (MCBs) in all floors.
  - b. No Overloading of power sockets in any Educational Building.
  - c. 10 years old wiring to be changed, especially where high power consuming appliances such as Air conditioners, Electrical/Mechanical/Computer labs, High-tech labs, etc., are used.
  - d. Grounding/Earthing shall be done.
  - e. Lightening conductors may be provided for high-rise buildings exceeding 5 floors.
  - f. No High Tension Lines should run inside or in close proximity (< 6 meters) to any Educational institution buildings.
  - g. No charging for EV vechiles @ cellars of School/College buildings.

Let the above be tested and certified by any electrical Engineer without regard to any Jurisdiction under employment of Government of Andhra Pradesh once a year.

4. As the ensuring safety is a continuous learning process, we will advise from time to time, practical , modern , reliable but not too hard or that require major modifications to your building structure. And you shall undertake to observe these precautions to enhance fire safety.
5. Therefore, this building meets the “**reasonable fire safety criteria**” as envisaged in NBC and hence the Fire No Objection Certificate for Occupancy is issued.
6. As a Policy, no retrospective application of rules shall be made for building as long as they comply with that NOC requirements till the life of the building.
7. Any clarifications, you are welcome to meet the DG, Fire Services (9441236448) without appointment in his office as ensuring fire safety with better and affordable technology is a continuous learning and collaborative endeavour.(for school fire safety mock drill, visit [https://www.youtube.com/watch?v=OW-oyYEAT\\_4](https://www.youtube.com/watch?v=OW-oyYEAT_4))

Your Sincerely,

  
28/7/2021

Director General

State Disaster Response & Fire Services  
Andhra Pradesh, Vijayawada.

To

The Management of TINY TOTS EM HIGH SCHOOL, TINY TOTS EM HIGH SCHOOL,  
Sullurupeta - 524121, Tirupati District, Andhra Pradesh

Copy to the District Educational Officer, Concerned.

Copy to the Secretary Board of Intermediate Education, Andhra Pradesh, Vijayawada